

Thermal Evaluation of Applying Combined Cycle Mode to Beijee Gas Turbine Generators

A. Youns Fathi

Mechanical Engineering Department
University of Mosul, College of Engineering,

Abstract:

Exhaust gases of gas turbine generators contain a significant amount of thermal energy which can be recovered externally or internally to the cycle itself. The most effective technology option for external heat recovery is the combined gas-steam power plant. The internal recovery conventional solutions are based on thermodynamic regeneration and steam injection.

In this study a thermal analysis and performance evaluation has been carried out to investigate the benefit of applying combined cycle power plant on Beijee simple gas turbine generators. Beijee gas turbine generator has been modeled and simulated to observe its performance including power output , thermal efficiency , specific fuel consumption and exhaust gas temperature as it is operating for the time being. Thereafter, simulation was carried out to investigate the performance of the suggested unit when a combined cycle power plant is used.

Results show that a significant improvement in the performance of Beigee gas turbine unit when a combined cycle mode is applied. For example the power output is found to be increased nearly by 49.3%, the thermal efficiency increased nearly by 20% and the specific fuel consumption decreased nearly by 10%.

التقييم الحراري لوحدات بيجي الغازية بتطبيق نظام الوحدات التوليد المركبة

عبدالكريم يونس فتحي

مدرس مساعد

جامعة الموصل – كلية الهندسة - قسم الهندسة الميكانيكية

الخلاصة

تحتوي غازات العادم للوحدات الغازية على كمية من الطاقة الحرارية والتي يمكن الاستفادة منها ضمن الدورة نفسها او خارجيا عن طريق مبادل حراري. ان من اهم التقنيات المتاحة للاستفادة من الطاقة الحرارية لغازات العادم خارجيا هي وحدات التوليد المركبة . بينما يمكن الاستفادة ضمنا من الطاقة الحرارية عن طريق مبادل حراري داخلي لتسخين الهواء قبل دخوله غرفة الاحتراق او عن طريق حقن البخار.

تم في هذه الدراسة إجراء تحليل حراري و تقييم أداء لمعرفة مقدار الفائدة المرجوة في حالة تطبيق وحدة توليد مركبة على الوحدات الغازية في محطة بيجي الغازية. تم نمذجة وحدة غازية مشابهة لتلك الموجودة في محطة بيجي ، و تم ملاحظة الأداء والذي شمل كل من القدرة المتولدة، الكفاءة الحرارية ، الاستهلاك النوعي للوقود بالإضافة إلى درجة حرارة غازات العادم ، بعد ذلك تم ملاحظة أداء الوحدة المركبة المقترحة.

بينت النتائج التي تم الحصول عليها إن أداء الوحدة الغازية في محطة بيجي الغازية يتحسن كثيرا عند تطبيق الوحدات المركبة. فمثلا وجد ان القدرة الناتجة تزداد بمقدار تقريبا 49.3% و في حين ان الكفاءة الحرارية تزداد تقريبا بمقدار 20% بينما وجد ان الاستهلاك النوعي للوقود ينخفض تقريبا بما مقداره 10%.

Received: 24 – 4 - 2011

Accepted: 30 – 6 – 2011

Introduction

The use of gas turbines for power generation has been increased recently and likely to continue to do so in the near future. This is due to low capital cost to power ratio, the high flexibility and reliability achievable with simple cycle configuration as well as the high efficiency of integrated solutions of waste heat recovery [1-6]. Thermal energy available in the exhaust of gas turbine generator is usually recovered by means of steam bottoming cycle. However, over the past ten years, the combined gas-steam cycle has become the leading technology for electricity generation, and now days are widely adopted in power plant installation[6-12].

Beijee gas turbine power plant station comprises of four gas turbine generators of 150 MW power output at ISO condition operating on simple cycle mode with compressor pressure ratio of 11 and turbine inlet temperature of 1060 °C . Thus all thermal energy available in the exhaust gases is expelled to atmosphere with out being used for further thermal process. Hence in the current study an investigation is performed to assess the benefit of having a heat recovery steam generator for producing a superheated steam, by extracting thermal energy from gas turbine exhaust, to be directed via a steam turbine for further power production.

Combined Cycle Power plant

A typical combined cycle power plant is shown in figure (1). The topping cycle is an open Brayton cycle consisting of a compressor, combustion chamber and a gas turbine. A generator converts output shaft power to electric power. Exhaust gases from the topping cycle provides thermal energy to superheat steam in the steam cycle –based bottoming cycle. A heat recovery steam generator (HRSG) that includes an economizer, evaporator and superheater convert compressed liquid water exiting the pump into superheated steam.

Heat recovery steam generator play a very important role in combined cycle power plant [8, 10], steam is generated at appropriate temperature and pressure to be provided to steam turbine for further electric power production.

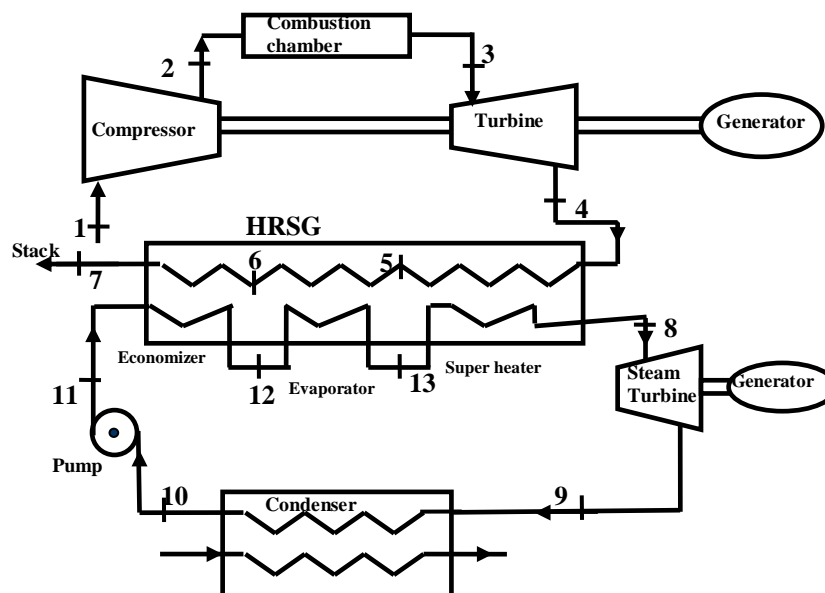


Figure (1): Combined Gas-Steam Power Plant

The combined gas-steam power plant produces power from the gas turbine and the steam turbine, while only power is required to drive the compressor and the pump.

Thermodynamic Model

The thermal system to be simulated comprise of a single shaft gas turbine for electricity production similar to those installed at Bejee gas turbine power station as shown in figure (2), a single pressure heat recovery steam generator and a steam turbine for further power production.

Gas Turbine Model

Gas turbines are steady flow heat engines consisting of three main components, an axial flow compressor, a combustion chamber and an axial flow turbine. A schematic diagram for a simple gas turbine like those is used in Bejee power station is shown in figure (2).

Air is drawn into the gas turbine by the compressor, which compresses and delivers it to the combustion chamber. Within the combustion chamber the air is mixed with fuel and the mixture is ignited, producing a rise in temperature of exhaust gases. These exhaust gases enter the turbine, expand which produce work and finally discharge to atmosphere [1,2]. The reference thermodynamic cycle is an open Brayton- Joule cycle without regeneration.

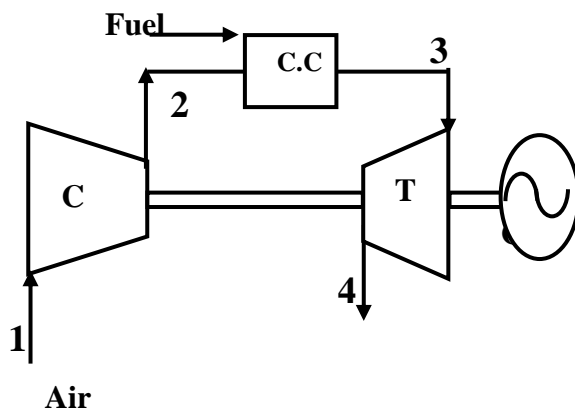


Figure (2): Simple single shaft gas turbine

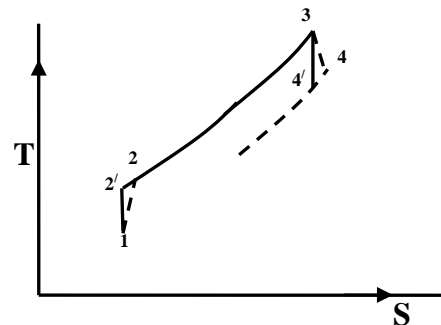


Figure (3) : T-S diagram for simple gas turbine

The following assumptions are considered in the present study:

1. the gas turbine operate on steady state
2. the specific heats of air and hot gases are temperature dependent
3. the fuel is natural gas
4. there is no pressure loss in the inlet and exhaust ducting
5. the amount of heat loss from the combustion chamber is small and can be ignored

Figure (3) show the T-S diagram for the single gas turbine cycle, the ideal and actual processes are represented in dashed and full line respectively. In the axial compressor, air is drawn from atmosphere and compressed from point 1 to point2. The mass flow rate is calculated as follows

$$m = \rho C_a A \quad (1)$$

where

ρ : density of air at inlet of compressor (kg/m^3)

C_a : axial velocity (m/s)

A: the annulus area (m^2)

The density of air is calculated as follows

$$\rho = \frac{P_1}{R T_1} \quad (2)$$

The ideal compressor exit temperature may be obtained using the following formula

$$T_{2'} = T_1 (r_p)^{\frac{\gamma_a - 1}{\gamma_a}} \quad (3)$$

And by introducing the compressor isentropic efficiency, the actual compressor exit temperature can be obtained as

$$T_2 = \left[\frac{(T_{2'} - T_1)}{\eta_c} + T_1 \right] \quad (4)$$

Hence, the compressor work can be determined as follows

$$W_c = m c_{p_a} (T_2 - T_1) \quad (\text{kW}) \quad (5)$$

In the combustion chamber, the heat supplied is due to combustion of hydrocarbon fuel (Natural gas), which is considered as CH_4 of lower calorific value of 50000 kJ/kg in present study, therefore, the amount of heat added can be obtained as follows

$$Q_{\text{add}} = m_f * \text{LCV} \quad (6)$$

Also

$$Q_{\text{add}} = m_a c_{p_g} (T_3 - T_2) \quad (7)$$

However, the turbine inlet temperature (TIT) is limited to 1060 °C due to metallurgical limit. Hence, the mass flow rate of fuel is calculated according to this temperature. Hot gases leave the combustion chamber and enter the axial flow turbine, expand to atmospheric pressure. Hence, the isentropic turbine exit temperature is given as

$$T_{4'} = T_3 * \frac{1}{(r_p)^{\frac{\gamma_g - 1}{\gamma_g}}} \quad (8)$$

And the actual turbine exit temperature is obtained as

$$T_4 = T_3 - \eta_{\text{tb}} (T_3 - T_{4'}) \quad (9)$$

The turbine work is calculated as follows

$$W_t = m_a c_{p_{\text{exh}}} (T_3 - T_4) \quad (\text{kW}) \quad (10)$$

The power output is obtained as follows

$$P_{\text{GT}} = W_t - W_c \quad (\text{kW}) \quad (11)$$

The thermal efficiency is found using the following equation

$$\eta_{\text{GT}} = \frac{P_{\text{Gt}}}{Q_{\text{add}}} = \frac{P_{\text{GT}}}{m_f * \text{LCV}} \quad (12)$$

And finally the specific fuel consumption is obtained as follows

$$SFC_{GT} = \frac{m_f}{P_{GT}} * 3600 \quad (\text{kg/kW.h}) \quad (13)$$

Heat Recovery Steam Generator Model

The performance of the heat recovery steam generator (HRSG) strongly affects the overall performance of combined cycle power plant. HRSG performance is usually based on the concept of pinch point and approach point that govern the gas and steam temperature profile. The pinch point represent the difference between the gas temperature leaving the evaporator and saturation temperature, while the approach point temperature is the difference between the water temperature leaving the economizer and saturation temperature as shown in figure(4).

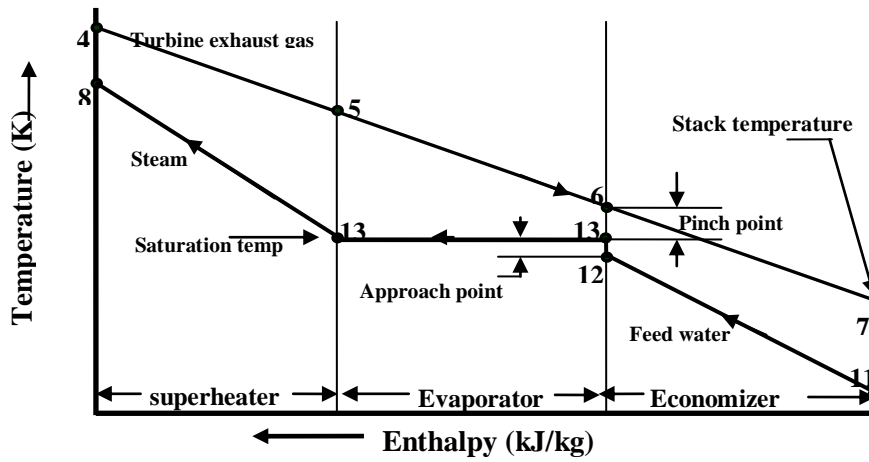


Figure (4): Temperature profile in a single pressure HRSG

In present study a single pressure heat recovery steam generator is considered which consist of economizer, evaporator and super heater as shown in figure (1). The waste heat from gas turbine is recovered in generating steam at required pressure and temperature.

The amount of heat available in gas exhaust can be obtained as follows:

$$Q_{exh} = m_{exh} c_{p_{exh}} (T_4 - T_5) \quad (\text{kW}) \quad (14)$$

The amount of heat transferred to the feed water in the economizer can be worked out as follows

$$Q_{ec} = m_w \epsilon_{ec} (h_{12} - h_{11}) \quad (\text{kW}) \quad (15)$$

The amount of heat transferred in the evaporator to get saturated steam may be estimated as follows

$$Q_{ev} = m_s \epsilon_{ev} (h_{13} - h_{12}) \quad (\text{kW}) \quad (16)$$

Finally, the saturated steam leaving the evaporator enter the super heater to be heated to superheated temperature , hence the amount of heat absorbed by the steam in the super heater is given as

$$Q_{sup} = m_s \epsilon_{sup} (h_8 - h_{13}) \quad (\text{kW}) \quad (17)$$

Therefore, the total heat gained by the heat recovery steam generator from the gas turbine exhaust is calculated as

$$Q_{HRSG} = Q_{ec} + Q_{ev} + Q_{sup} \quad (\text{kW}) \quad (18)$$

Steam Turbine Model

Steam generated in the heat recovery steam generator is directed to be expands in steam turbine to condenser pressure for further power production. The steam turbine power out put can be calculated as follows

$$P_{st} = m_s (h_8 - h_9) \quad (\text{kW}) \quad (19)$$

Hence, the total power out put of the combined cycle is given as

$$P_{ccGT} = P_{GT} + P_{st} \quad (\text{kW}) \quad (20)$$

The combined cycle efficiency can be obtained a follows

$$\eta_{ccGT} = \frac{P_{GT} + P_{st}}{m_f * LCV} \quad (21)$$

The specific fuel consumption is obtained as follows

$$SFC_{ccGT} = \frac{m_f}{P_{ccGT}} * 3600 \quad (\text{kg/kW.h}) \quad (22)$$

Result and Discussion

The thermodynamic analysis of present Beigee simple gas turbine and the suggested combined cycle power plant with single pressure heat recovery steam generator has been carried out for the following input parameters :- TIT=1060 °C, m=509 kg/s, rp=11 , $\eta_c= 0.88$ and $\eta_{tb} = 0.9$.

First, the performance of Beigee simple gas turbine generator is performed to investigate the effect of ambient temperature on its performance. Figure (5) shows the relationship between the mass flow rate of air discharged by the compressor and the ambient temperature. It was found that there is nearly 11.6% reduction in the mass of air from the design value as the temperature reaches 45 °C. This is due to the decrease in density of the ambient air with the increase of its temperature, which affects the mass flow rate of air delivered by the compressor.

As expected, the power output found to decrease as ambient temperature increase, as shown in figure (6). This is due to the reduction in the mass flow rate of air with ambient temperature rise, which affect the pressure ratio and the turbine work and ultimately the power output. The reduction in power output found to be 25.3% as the ambient temperature reaches 45 °C. Figure (7) shows the

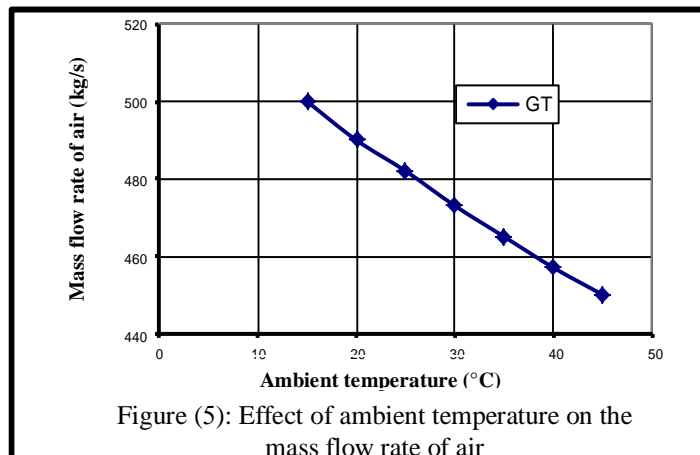


Figure (5): Effect of ambient temperature on the mass flow rate of air

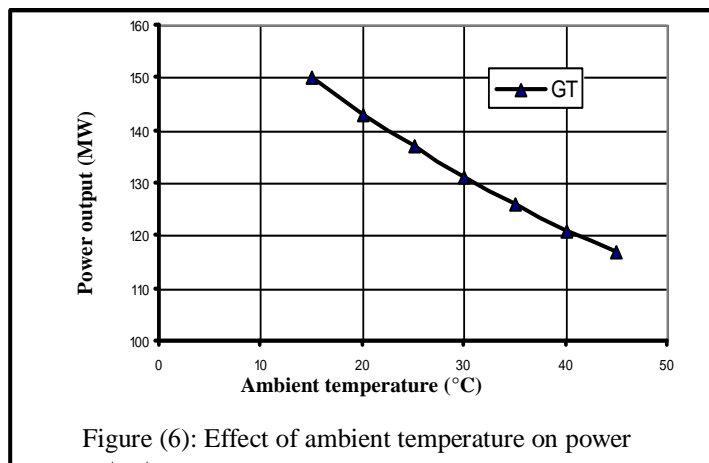


Figure (6): Effect of ambient temperature on power

relationship between the thermal efficiency and ambient temperature. It can be seen that the thermal efficiency decrease with ambient temperature. This may be due to the decrease in the power output and the slight increase in specific fuel consumption. In this case, the thermal efficiency was found to decrease by nearly 8% as the ambient temperature approaches 45 °C.

In figure (8), the specific fuel consumption is plotted against the ambient temperature. It was found that the specific fuel consumption increases by approximately 7.4%. The relatively high increase is due to the reduction in the pressure ratio and compressor work, which made it necessary to increase the mass flow rate of fuel to keep the turbine inlet temperature constant at 1060 °C. Figure (9) shows the relationship between the ambient temperature and exhaust gas temperature. It can be seen that exhaust gas temperature increase nearly by 30 °C as the ambient temperature approaches 45 °C.

Thereafter, the effect of pinch point and approach point temperature was investigated. Figure (10) shows the relationship between the pinch point and the mass flow rate of steam generated by the heat recovery steam generator. It can be seen that the mass of generated steam decreases nearly by 21.5% as the pinch point increase from 5 °C to 40 °C.

Because of that, the steam turbine power output decrease nearly by 18.9% as pictured in figure (11). This is due to reduction in the heat transfer that take place in the heat recovery steam generator which effect its thermal efficiency a given in figure (12). Similar results found for the approach point temperature affect, as shown in figures (13), (14) and (15). It was found that the steam generated by the HRSG, steam turbine output and the heat recovery steam generator thermal efficiency decreases nearly by 14%, 19% and 15.6% respectively as the approach point increase from 5 °C to 40 °C.

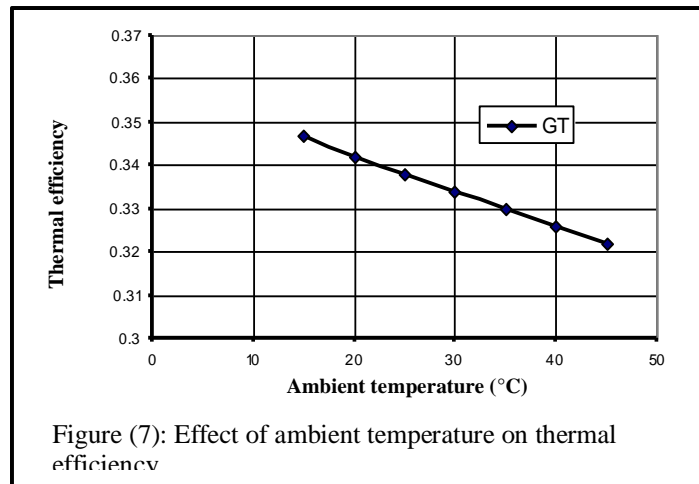


Figure (7): Effect of ambient temperature on thermal efficiency

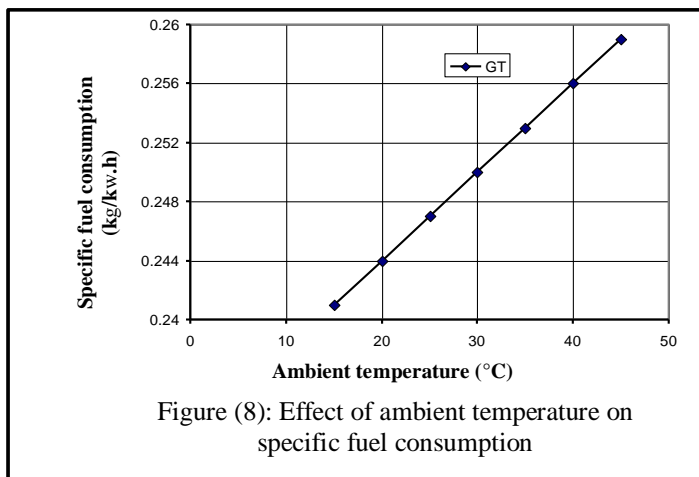


Figure (8): Effect of ambient temperature on specific fuel consumption

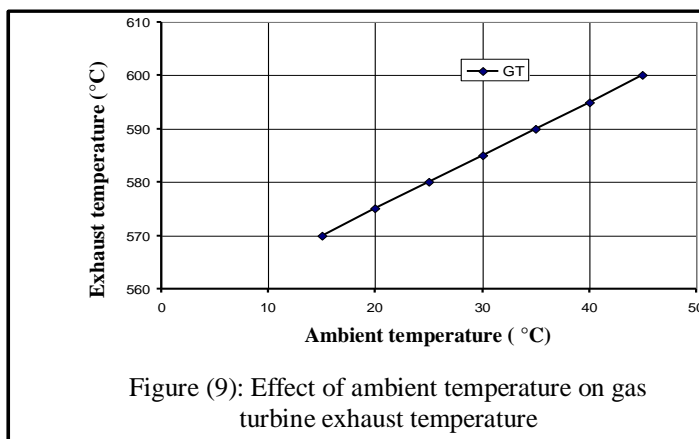


Figure (9): Effect of ambient temperature on gas turbine exhaust temperature

Finally, the thermal benefit of applying combined cycle mode on Beigee simple gas turbine generator is pictured in figure (16), (17) and (18). Examining Figure (16), it can be seen that the power output produced by the combined cycle is higher than that produced by simple gas turbine unit nearly by 49.3%. This is due to the extra power produced by the bottoming cycle (steam cycle) which takes its thermal energy from the exhaust gases. Figure (17) give a comparison of thermal efficiency of simple gas unit and combined cycle as function of ambient temperature. This figure indicates that the thermal efficiency can be increased nearly by 20% when combined cycle mode is used. On other hand the specific fuel consumption was found to be decreased nearly by 10% as shown in figure (18).

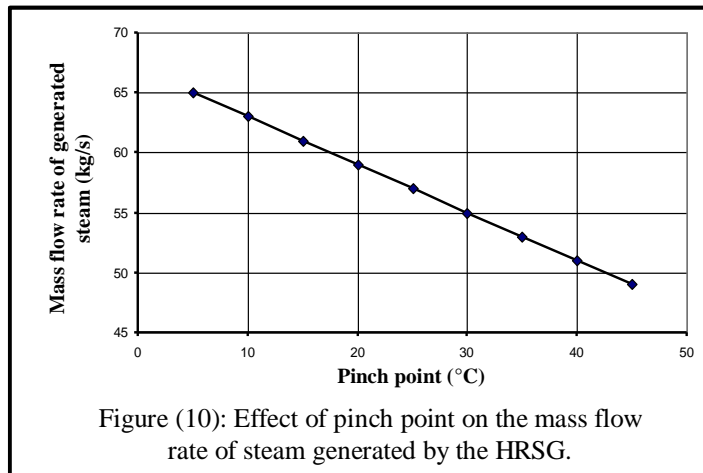


Figure (10): Effect of pinch point on the mass flow rate of steam generated by the HRSG.

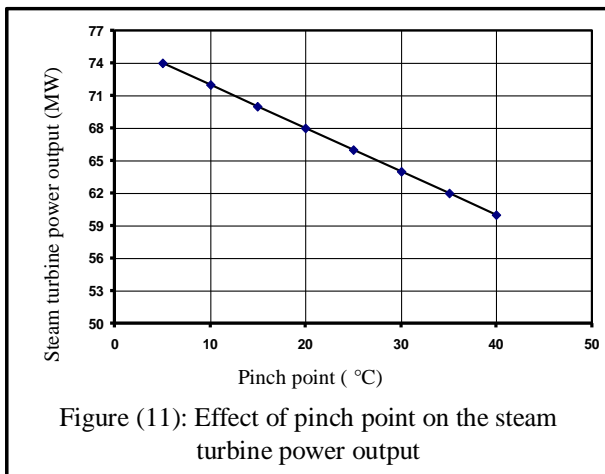


Figure (11): Effect of pinch point on the steam turbine power output

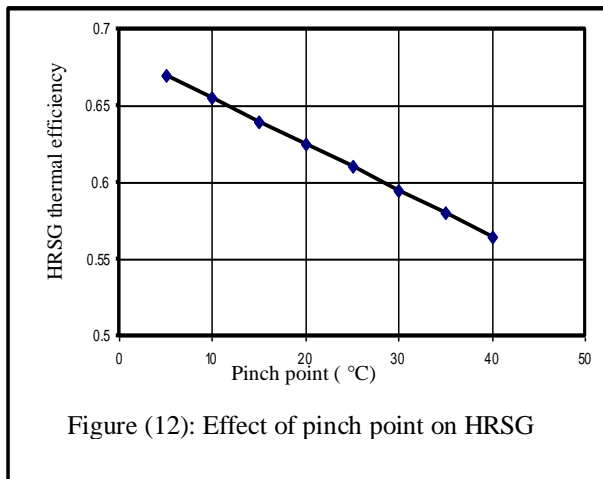


Figure (12): Effect of pinch point on HRSG

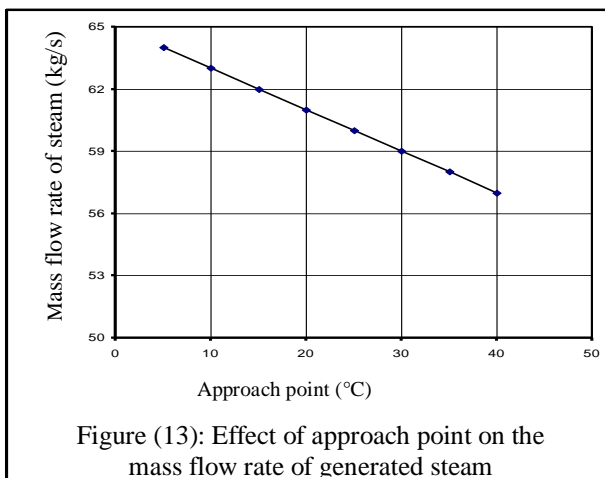


Figure (13): Effect of approach point on the mass flow rate of generated steam





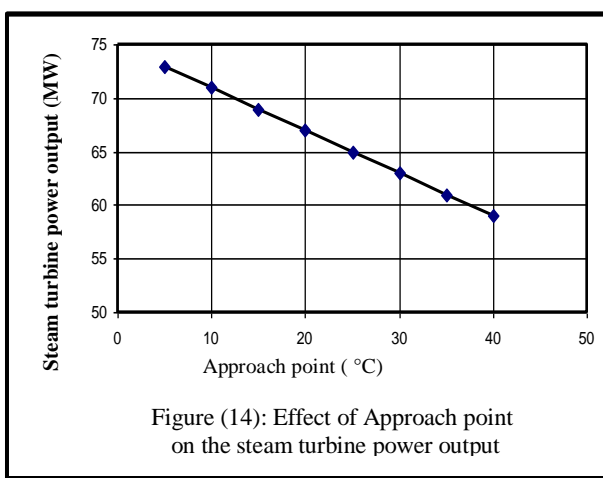


Figure (14): Effect of Approach point on the steam turbine power output

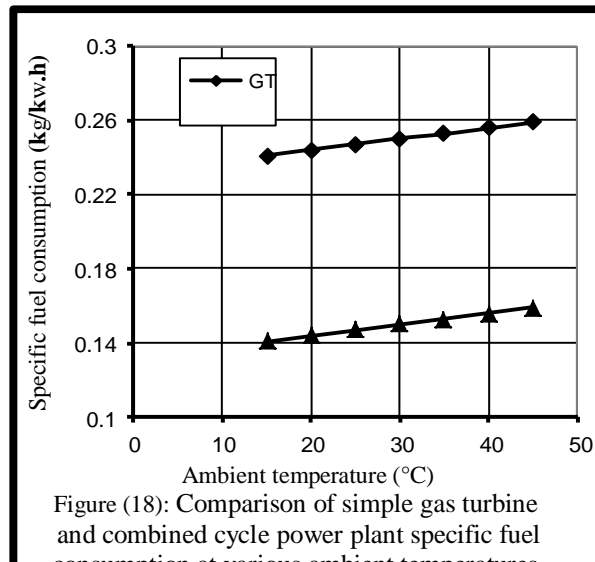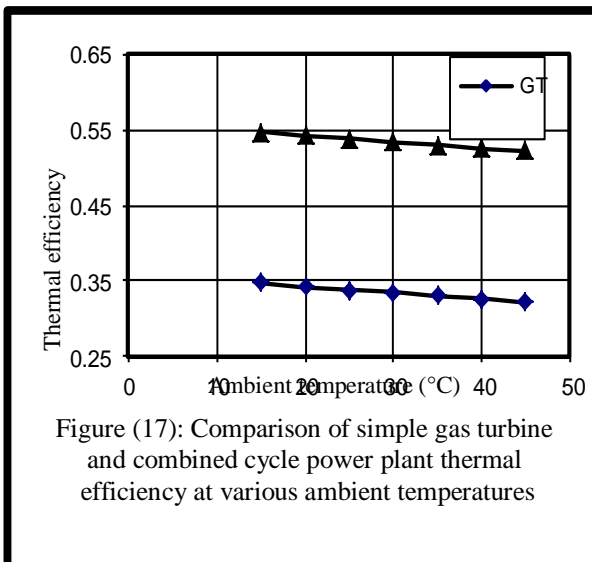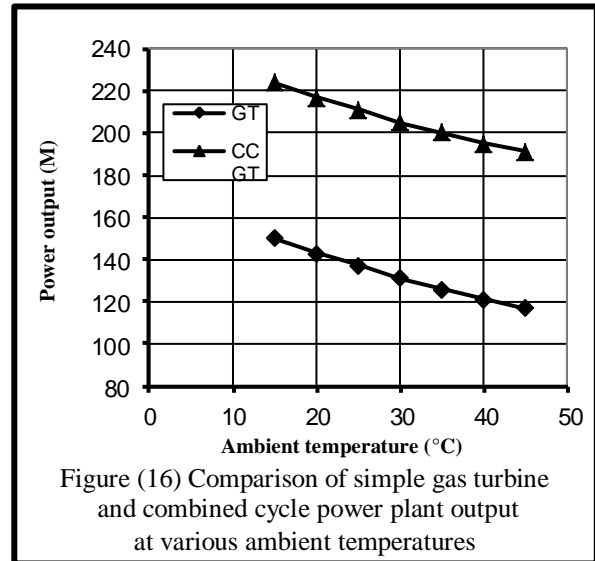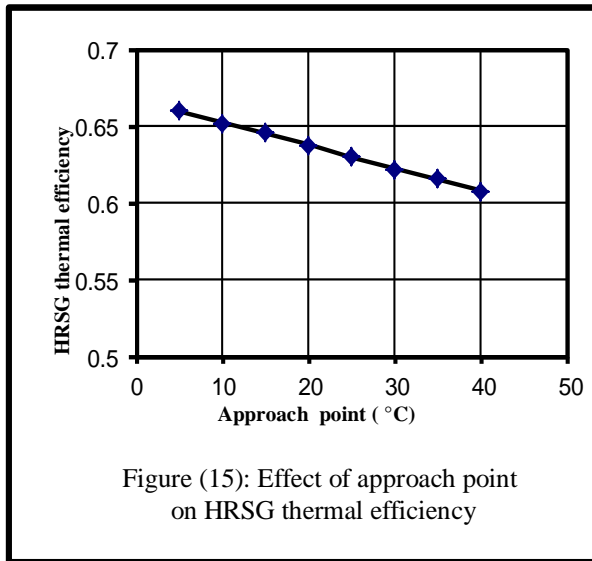

Nomenclature

A	Annulus area (m ²)
Ca	Axial velocity (m/s)
Cp	Specific heat at constant pressure (kJ/kg.K)
h	Enthalpy (kJ/kg)
LCV	Lower calorific value (kJ/kg)
m	Mass flow rate (kg/s)
P	Pressure (bar)
P	Power (KW)
Q	Heat (KW)
rp	Pressure ratio
SFC	Specific fuel consumption (kg/kw.h)
W	Work (KW)
T	Temperature (K)

Subscripts

a	Air
c	Compressor
CCGT	Combined cycle
ec	Economizer
ev	Evaporator
exh	Exhaust gases
f	Fuel
GT	simple gas turbine
HRSG	Heat recovery steam generator
s	Steam
st	Steam turbine
sup	Superheater
tb	Turbine

References

- 1- Malewski W. F., and Holldorft, G. M., Power Increase of Gas turbine by Inlet Air Precooling with Absorption Refrigeration Utilizing Exhaust Waste Heat, ASME International Gas Turbine Conference, Paper No 86-GT-67, Duseeldorf June 1986
- 2- De Lucia M., Bronconi, R., and Carneval, E., Performance and Economic Enhancement of Cogeneration Gas Turbine Through Compressor Inlet Air Cooling, ASME Journal of Engineering for Gas Turbine and Power, Vol. 116, pp.360-365, 1994.
- 3- A. Ongiro, V.I.Ugursal , A.M.Al-Taweel and J.D. walker , Modeling of Heat Recovery Steam Generator Performance , Applied Thermal Engineering Vol.17, No.5, pp427-446, 1997
- 4- A.Agazzani, A.F.Maardo, A Tool for Thermo-economic Analysis and Optimization of Gas, Steam and Combine Plants, Journal of Engineering for Gas Turbine and Power ,Vol119, pp885-892, Oct. 1997
- 5- Jan Szargut, Influence of the Ambient Temperature on the Operational Indices of the Gas Turbine Set, International Journal of Energy Research, Vol. 24, pp. 821-830, 1999.
- 6- Alaandro Franco, Claudio Casarosa, On Some Perspective for Increasing the Efficiency of Combined Cycle Power Plants, Applied Thermal Engineering,Vol.22, pp1501-1518, 2002.
- 7- X. Q. Kang, R.Z . Wang, X.H.Huang, Energy Optimization Mode for A CCHP System with Available Gas Turbines, Applied Thermal Engineering,Vol.5, pp377-391, 2005.
- 8- Naradasu Ravi Kumer, Knoijeti Rama Krishna and Alluru Venkata Sita Rama, Thermodynamic Analysis of Heat Recovery Steam Generator in Combined Cycle Power Plants, Thermal Science Vol.11, No.4, pp 143-156,2007
- 9- A. Khaliq, K.Choudhary, Combined First and Second Law Analysis of Gas Turbine Cogeneration System with Inlet Cooling and Evaporative After cooling of the Compressor Discharge , Journal of Engineering for Gas Turbine and Power, Vol. 19 , pp1004-1011, Oct. 2007
- 10- Roberto Carapellucci, A Unified Approach to Assess Performance of Different Techniques for Recovering Exhaust Heat From Gas Turbines, Energy Conversion and Management Vol.50, pp1218-1226, 2009.
- 11- Ali Behbahani et al , Optimization of Fire Tube Heat Recovery Steam Generators for Cogeneration Plant Through Genetic Algorithm, Applied Thermal Engineering,Vol.30, pp2378-2385, 2010.
- 12- Ashok Kumar, S S Kahwaha and R S Mishra, Thermodynamic Analysis of a Regenerative Gas Turbine Cogeneration Plants, Journal of Scientific and Industrial Research, Vol.61, pp 225-231, March 2010

The work was carried out at the college of Engineering. University of Mosul